



### CONCRETE NOTES

- CONCRETE WORK SHALL BE EXECUTED IN STRICT COMPLIANCE WITH THE LATEST EDITION OF THE AMERICAN CONCRETE INSTITUTE (A.C.I.) MANUAL OF CONCRETE PRACTICE.
- FOUNDATION DESIGN IS BASED UPON AN ASSUMED SOIL BEARING CAPACITY OF 2,000 PSF. IF WET OR UNUSUAL SOIL CONDITIONS ARE ENCOUNTERED, NOTIFY THE DESIGNER AND CONSTRUCTION INSPECTOR BEFORE PROCEEDING WITH THE WORK.
- ALL CONCRETE SHALL BE TYPE 1 CEMENT WITH A COMPRESSIVE STRENGTH OF 4,000 PSI @ 28 DAYS WITH 4" SLUMP.
- COORDINATE WORK OF OTHER TRADES REQUIRED TO BE INSTALLED IN, UNDER, OR THROUGH CONCRETE PRIOR TO PLACEMENT OF CONCRETE. INSTALL ALL ANCHORAGES AND SLEEVES REQUIRED FOR THE INSTALLATION OF WORK BY OTHER TRADES.
- SAWED CONTROL JOINTS SHALL BE CLEANED FREE OF ALL DEBRIS AND FILLED WITH SEALANT. SEE SECTION 07900.
- COPPER PIPING RUN THROUGH CONCRETE WORK SHALL BE RUN THROUGH PVC SLEEVES.
- SEE SPECIFICATION SECTION 03300 CONCRETE FOR ADDITIONAL INFORMATION.

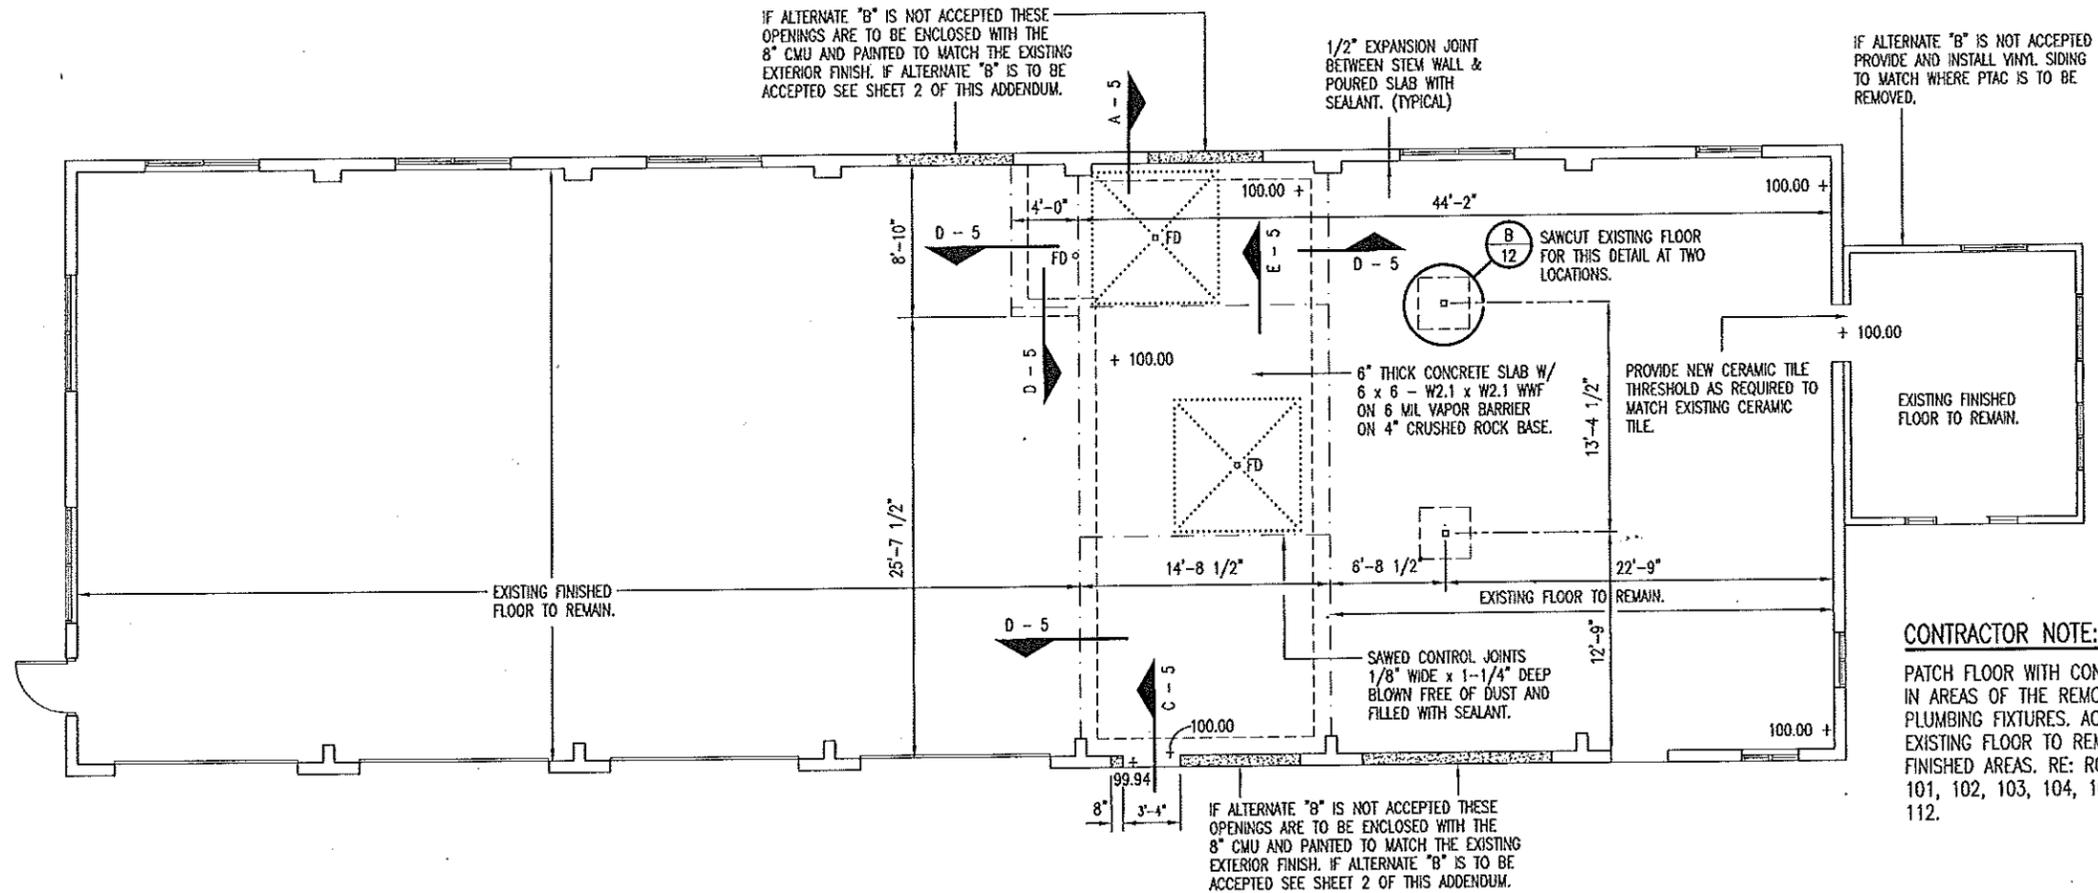

**A**  
1  
**CONCRETE SLAB PLAN**  
SCALE: 3/32" = 1'-0"




### ADDENDUM #1

# CONCRETE SLAB PLAN

MISSOURI DEPARTMENT  
OF TRANSPORTATION  
DIVISION OF GENERAL SERVICES  
FACILITIES MANAGEMENT

BOLIVAR MAINTENANCE BUILDING RENOVATION  
2816 West Broadway  
Southwest District - Polk County

DESIGN BY: LARRY CARVER  
DRAWN BY: LARRY CARVER  
DATE: 4-12-13  
Sheet  
1 OF 2

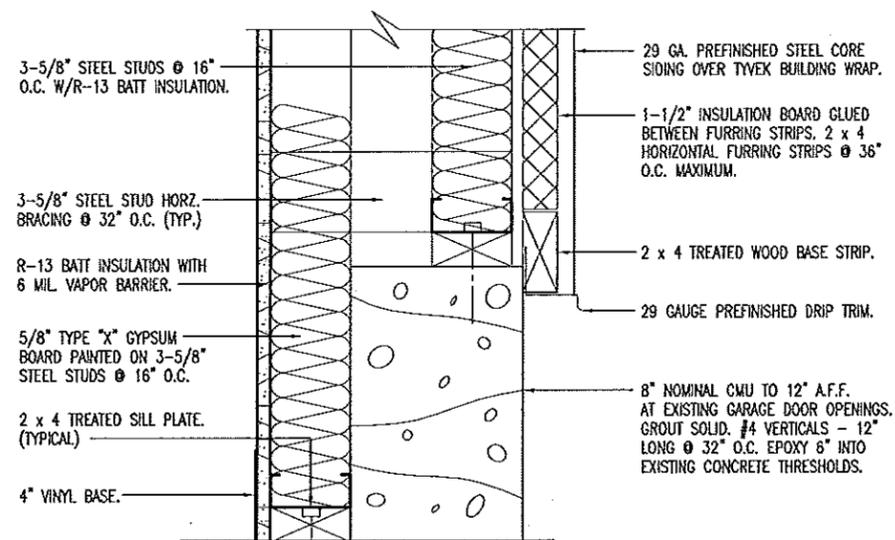


TYPICAL AT EACH GARAGE  
DOOR TO BE REMOVED TO  
EAVE HEIGHT.

A  
2

DETAIL

SCALE: 1-1/2" = 1'-0"

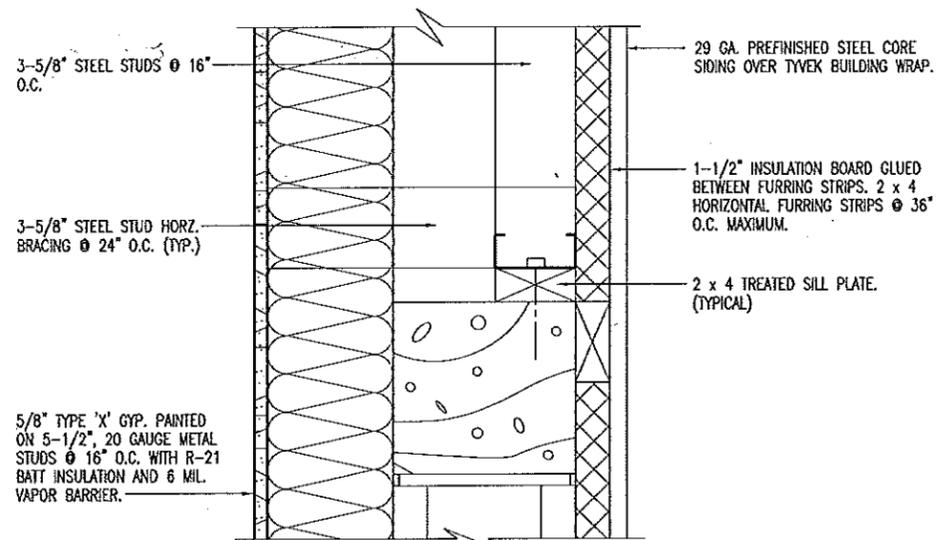

TYPICAL AT EACH WINDOW  
TO BE REMOVED TO EAVE  
HEIGHT.

B  
2

JAMB SIMILAR.  
WINDOW SILL

SCALE: 1-1/2" = 1'-0"

ADDENDUM #1  
IF ALTERNATE "B" IS ACCEPTED.

DETAILS

MISSOURI DEPARTMENT  
OF TRANSPORTATION  
DIVISION OF GENERAL SERVICES  
FACILITIES MANAGEMENT

BOLIVAR MAINTENANCE BUILDING RENOVATION  
2816 West Broadway  
Southwest District - Polk County

DESIGN BY: LARRY CARVER  
DRAWN BY: LARRY CARVER  
DATE: 4-12-13  
Sheet  
2 of 2